


8' TREX HORIZONS COMPOSITE SINGLE AND DOUBLE GATE MPS

Trex Fencing Standard Gate Opening	Gate Opening	Gate Hardware Tolerance
Standard Single Gate	46-1/4"	1-7/8"
Large Single Gate	65-3/4"	1-7/8"
Standard Double Gate	90-1/2"	2-3/4"
Large Double Gate	130-1/2"	2-3/4"

DESIGN PRESSURE & REQUIRED FOOTER MOMENT				
Post Height (ft)	Vult (mph)	DP (psf)	Req. Moment for 46-1/4" Gate Leaf (lb-ft)	Req. Moment for 65-3/4" Gate Leaf (lb-ft)
8	110	16.5	3168	3696
8	115	18.1	3475	4054
8	130	23.1	4435	5174
8	145	28.7	5510	6429
8	165	37.2	7142	8333
8	180	44.3	8506	9923

*REQUIRED WINDSPEED IF WITHIN HVHZ

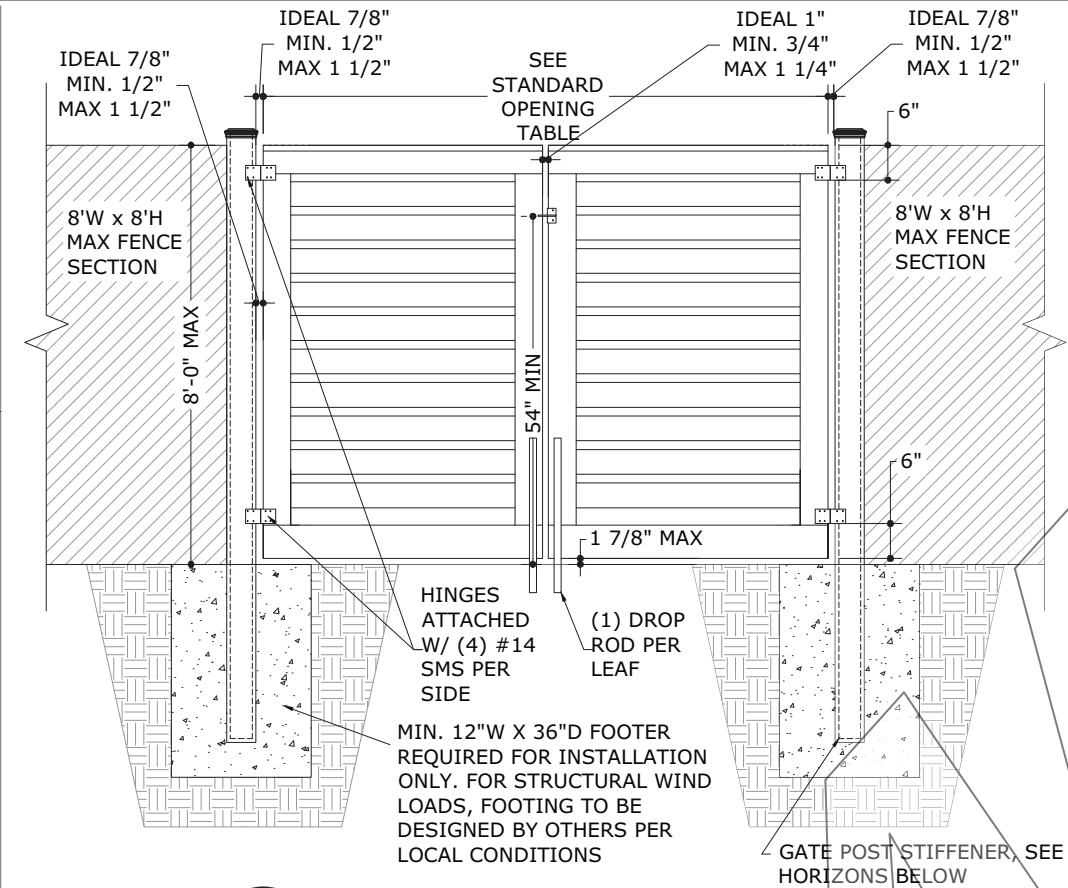


1 COMPOSITE DOUBLE GATE
1 SCALE: NTS
ELEVATION VIEW

GENERAL NOTES


- THIS STRUCTURE HAS BEEN DESIGNED AND SHALL BE FABRICATED IN ACCORDANCE WITH THE STRUCTURAL PROVISIONS OF THE 2012 & 2015 INTERNATIONAL BUILDING CODE & 2012 & 2015 INTERNATIONAL RESIDENTIAL CODE AS WELL AS CURRENT VERSIONS OF THE MN, NC, NJ, NY, OH, SC, VA BUILDING & RESIDENTIAL CODES AS APPLICABLE. STRUCTURE SHALL BE FABRICATED IN ACCORDANCE WITH ALL GOVERNING CODES. CONTRACTOR SHALL INVESTIGATE AND CONFORM TO ALL LOCAL BUILDING CODE AMENDMENTS WHICH MAY APPLY AND GOVERN. DESIGN CRITERIA OR SPANS BEYOND STATED HEREIN MAY REQUIRE ADDITIONAL SITE SPECIFIC SEALED ENGINEERING.
- DESIGN BASED ON ASCE 7-10 USING V_{ult} = SEE DESIGN PRESSURE TABLES (3 SEC GUST), EXPOSURE 'C', RISK CATEGORY 1, USING THE SOLID SIGN METHOD, 0% OPEN USED IN CALCULATIONS.
- THIS FENCE DESIGN TO BE USED AT GROUND SURFACE ONLY, WITH USE LIMITED TO DECORATIVE BARRIER PURPOSES ONLY. THIS FENCE IS NOT INTENDED TO MEET CODES GOVERNING ELEVATED BALCONIES OR STRUCTURAL RAILINGS.
- COMPOSITE WOOD MATERIAL INFORMATION** : ALL COMPOSITE WOOD MATERIAL TO HAVE A FLEX STR. OF 4000PSI MIN.
- ALL CONCRETE AND EPOXY TO REACH A MIN. COMPRESSIVE STRENGTH OF 3000 PSI IN 7 DAYS. CONCRETE FOOTERS SHALL CONTAIN MINIMUM 0.1% FIBERMESH CONTENT PER CUBIC YARD.
- THE CONTRACTOR IS RESPONSIBLE TO INSULATE ALL MEMBERS FROM DISSIMILAR MATERIALS TO PREVENT ELECTROLYSIS.
- SURROUNDING SOIL TO BE COMPACTED TO 98% OPTIMUM DENSITY, 2500 PSF MIN AND SHALL BE CLASSIFIED OR VERIFIED BY OTHERS PRIOR TO CONSTRUCTION AND SHALL BE SANDY GRAVEL CLASS ONLY.
- POOL ACCESS GATES WHEN PROVIDED SHALL BE AT LEAST 48" ABOVE GRADE & EQUIPPED WITH A SELF CLOSING, SELF LATCHING LOCKING DEVICE NOT LESS THAN 54" FROM BOT OF GATE. GATE MUST OPEN OUTWARD AWAY FROM POOL & MUST HAVE NO OPENING >1/2" WITHIN 18" OF RELEASE MECHANISM.
- ELECTRICAL GROUND, WHEN REQUIRED, TO BE DESIGNED & INSTALLED BY OTHERS.
- ENGINEER SEAL AFFIXED HERETO VALIDATES STRUCTURAL DESIGN AS SHOWN ONLY. USE OF THIS SPECIFICATION BY CONTRACTOR, et. al. INDEMNIFIES & SAVES HARMLESS THIS ENGINEER FOR ALL COST & DAMAGES INCLUDING LEGAL FEES & APPELLATE FEES RESULTING FROM MATERIAL FABRICATION, SYSTEM ERECTION, CONSTRUCTION PRACTICES BEYOND THAT WHICH IS CALLED FOR BY LOCAL, STATE, & FEDERAL CODES & FROM DEVIATIONS OF THIS PLAN.
- THIS DOCUMENT IS GENERIC AND DOES NOT PERTAIN TO ANY SPECIFIC PROJECT SITE. INFORMATION CONTAINED HEREIN IS BASED ON CONTRACTOR-SUPPLIED DATA AND MEASUREMENTS. ENGINEERING EXPRESS SHALL NOT BE HELD RESPONSIBLE OR LIABLE IN ANY WAY FOR ERRONEOUS OR INACCURATE DATA OR MEASUREMENTS. DIMENSIONS ARE SHOWN TO ILLUSTRATE DESIGN FORCES AND OTHER DESIGN CRITERIA. THEY MAY VARY SLIGHTLY, BUT MUST REMAIN WITHIN THE LIMITATIONS SPECIFIED HEREIN. WORK SHALL BE FIELD VERIFIED BY OTHERS PRIOR TO CONSTRUCTION. ENGINEERING EXPRESS SHALL BE NOTIFIED AND GIVEN AN OPPORTUNITY TO REEVALUATE OUR WORK UPON DISCOVERY OF ANY INACCURATE INFORMATION PRIOR TO MODIFICATION OF EXISTING FIELD CONDITIONS AND FABRICATION AND INSTALLATION OF MATERIALS. ALTERATIONS OR ADDITIONS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.
- ANYTHING LESS THAN THE HEIGHT AND POST SPACING SHOWN HEREIN MAY BE AS PER MANUFACTURER PLANS FOR DIMENSIONAL CONFORMITY, PROVIDED COMPONENTS AND EXTRUSIONS ARE PER THIS DESIGN AND THERE ARE NO INCREASED TRIBUTARIES.
- EXCEPT AS EXPRESSLY PROVIDED HEREIN, NO ADDITIONAL CERTIFICATIONS OR AFFIRMATIONS ARE INTENDED.

TREX HORIZONS® GATE PROFILES

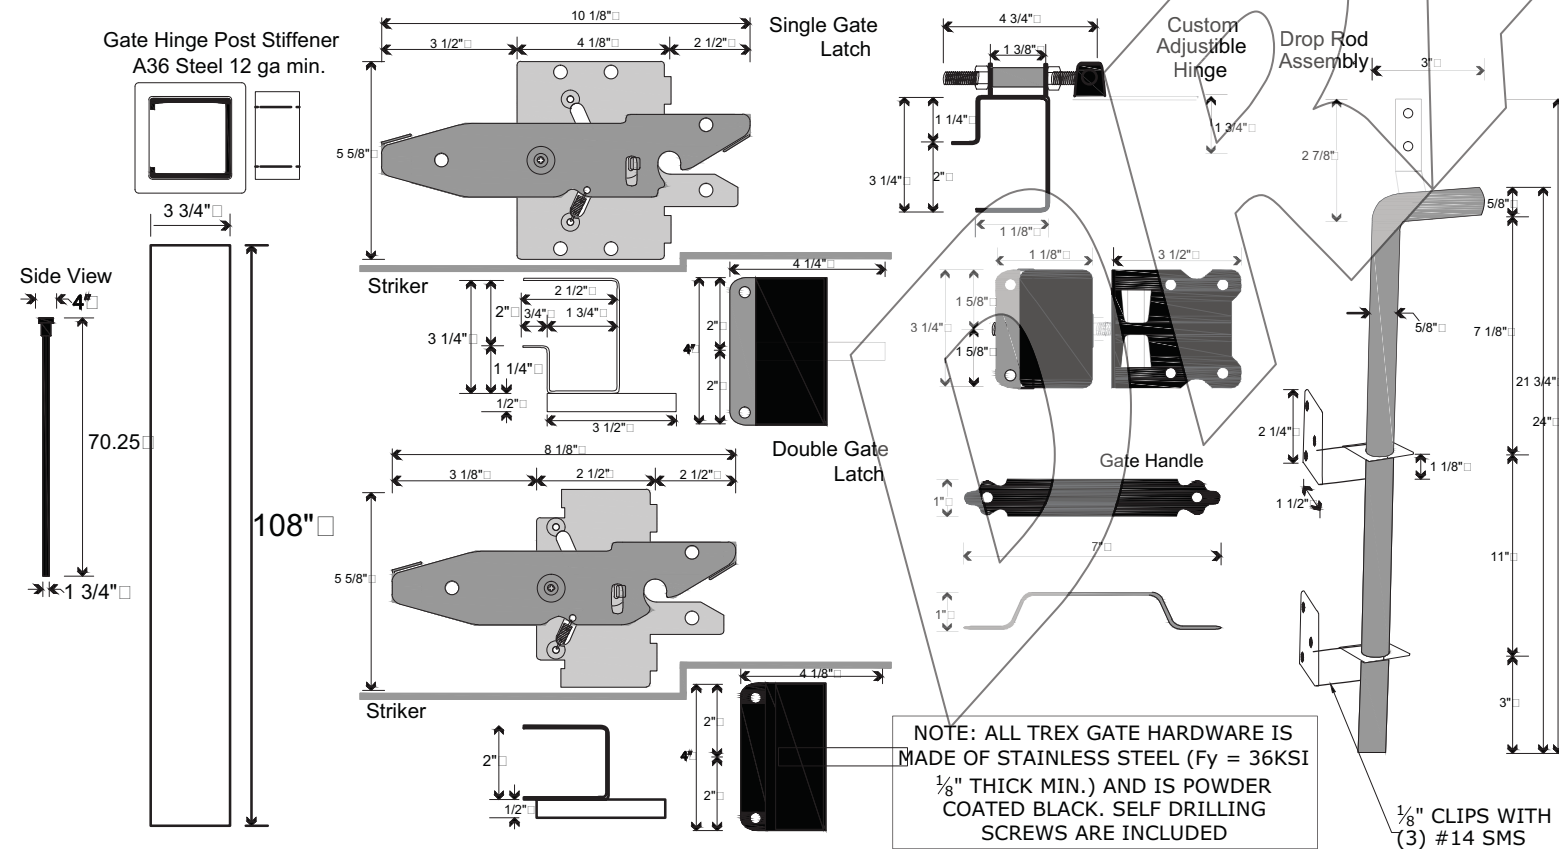


Optional:
Anti-Sag
Cable

- A Black vinyl wrapped steel cable
- B Cable clamp (2)
- C 'S' hook
- D 'D' rings (2)
- E 1" Self-drilling screws (2)
- F Turnbuckle

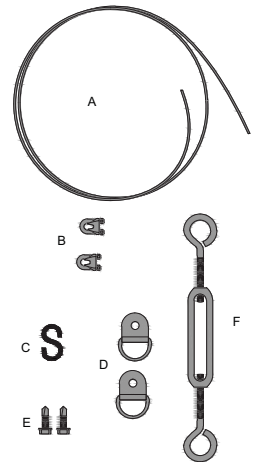

©2013 TFSC

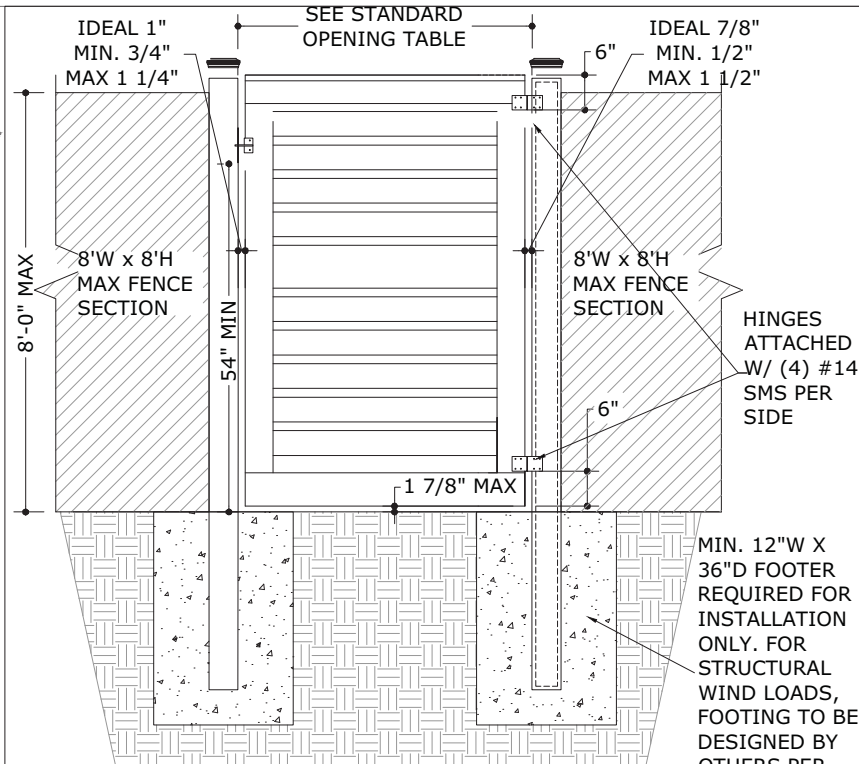

2 COMPOSITE SINGLE GATE
1 SCALE: NTS
ELEVATION VIEW

DAL:25555 CO:0053085 DC:920096 DE:15009 GA:027525 IN:10606888 KS:24215 KY:32975 LA:30341 MA:43224 MD:28152 ME:10478 MI:49491 MN:43001 MO:2003019621 MS:16927 NC:027234 NJ:24GE04353500, C/A: 24GA28220000 NY:079356, C/A: 0010167 OH:66438 PA:060991 RI:7928 SC:21507 TN:120330 TX:96064, C/A: F-11383 UT:10666708-2202 VA:0402 038109 WI:43753-6

FRANK L. BENNARDO, P.E.
PE#

08/14/2018

NOTICE: IF THIS SHEET DOES NOT CONTAIN AN ORIGINAL SIGNATURE & ENGINEER SEAL:

IF THERE IS A DIGITAL SIGNATURE ON SHEET 1, THIS SHEET IS PART OF A DIGITALLY SIGNED FILE, SHALL REMAIN IN DIGITAL FORMAT, & PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED. IF THERE IS NO DIGITAL SIGNATURE ON SHEET 1 OR THIS SHEET DOES NOT CONTAIN AN ENGINEER'S ORIGINAL SIGNATURE & SEAL, THIS SHEET IS A COPY/DRAFT.

FRANK L. BENNARDO, P.E.
160 SW 12th AVENUE, #106
DEERFIELD BEACH, FL 33442
Ph: (954) 354-0660 Fax: (954) 354-0443

POWERED BY THE INNOVATIONS OF
ENGINEERING EXPRESS
EXPERIENCE MORE AT ENGINEERINGEXPRESS.COM

Trex Fencing
www.Trexfencing.com
1.877.700.8739

TREX FENCING 6' GATE MPS
INTERNATIONAL BUILDING CODE
ASCE 7-10 'SOLID SIGN METHOD' 0% OPEN

REMARKS	DATE	DRWN	CHKD	JAC	FLB
2018 UPDATE	03/13/18				

THIS DOCUMENT IS THE PROPERTY OF ENGINEERING EXPRESS, AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN CONSENT OF ENGINEERING EXPRESS. ALTERATIONS, ADDITIONS, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

COPYRIGHT ENGINEERING EXPRESS®

16-3428

SCALE: NTS UNLESS NOTED

1 OF 1